




TOP

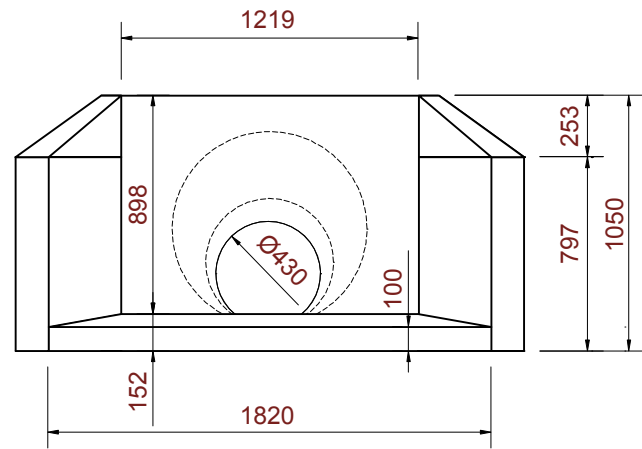


FRONT

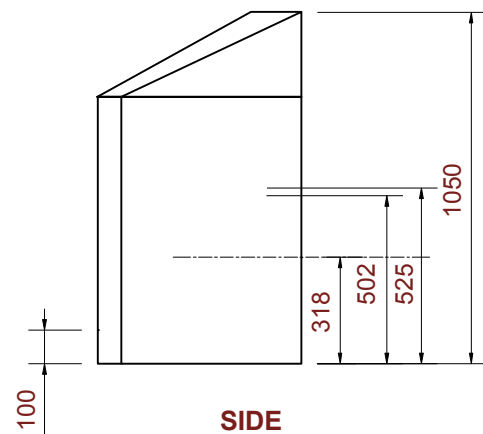

SIDE

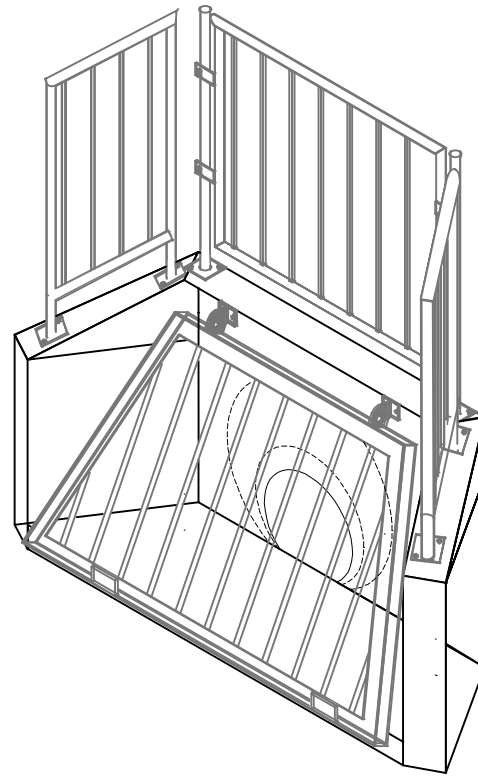


ISOMETRIC

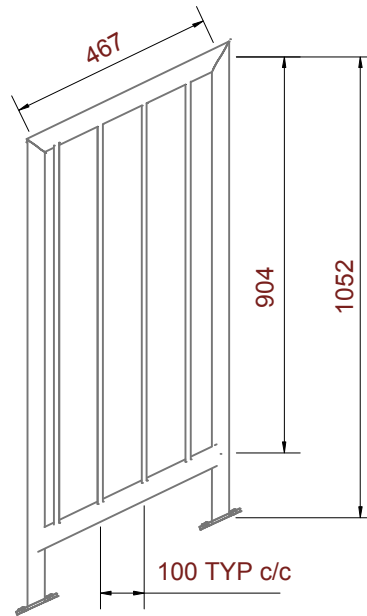


SIDE HAND RAIL TYPICAL


SHAW SUPPLIED ITEMS	
3	STAINLESS STEEL "L" BRACKETS
6	190mm (3/4") STAINLESS DROP-IN ANCHORS
6	190mm (3/4") x 380mm (1 1/2") BOLTS
6	190mm (3/4") WASHERS

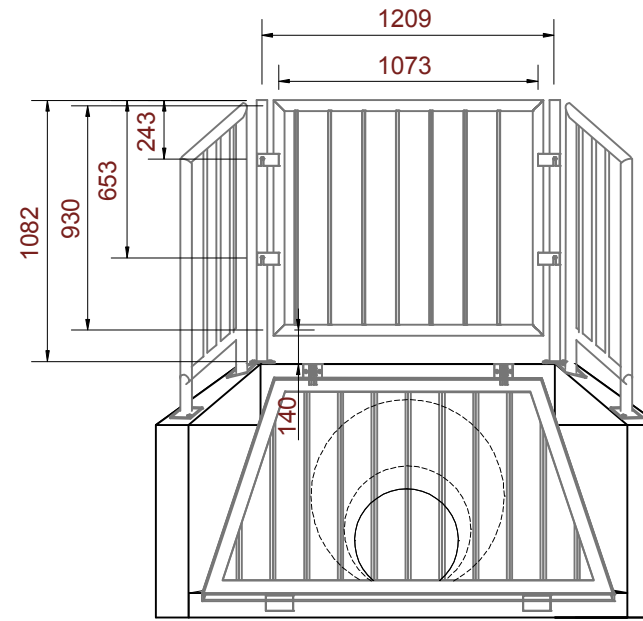

HAND RAIL

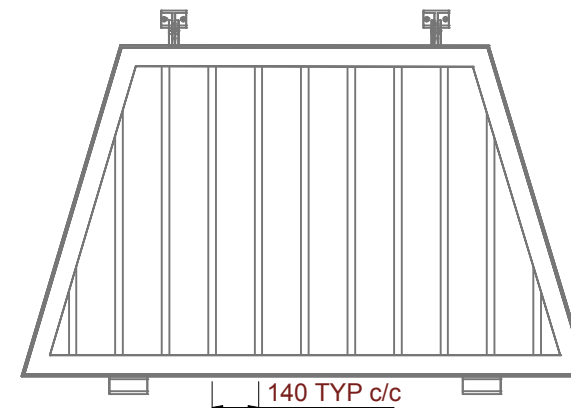

INFLOW

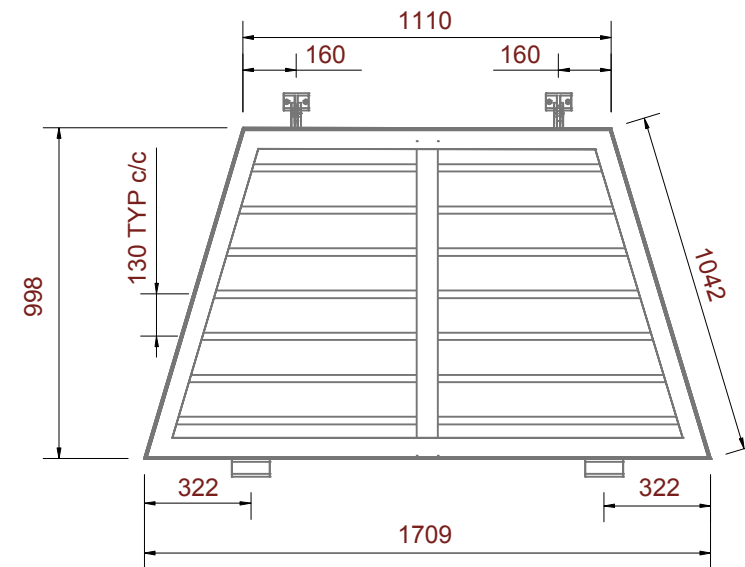

GRADE ELEVATION

NOTES

- GENERAL**
- FOR HANDLING, STORAGE, TRANSPORTATION AND ERECTION PROCEDURES PLEASE REFER TO "HEADWALL INSTALLATION GUIDE" AND "DAYTON/RICHMOND GUIDELINES FOR HANDLING CONCRETE PIPE AND UTILITY PRODUCTS".
  - WEIGHT = 1052 kg
  - TOLERANCE FOR STRUCTURAL ELEMENTS, MATERIALS & CONSTRUCTION CONFORM TO CAN/CSA A23.4 "PRECAST CONCRETE" CLAUSE 10.
  - PRECAST HEADWALL MUST BE FASTENED TO REINFORCED CONCRETE PIPE WITH SHAW SUPPLIED HARDWARE (SEE HEADWALL INSTALLATION GUIDE).
- GEOTECHNICAL**
- GEOTECHNICAL ENGINEER TO PROVIDE ON-SITE INSPECTION FOR PLACEMENT AND COMPACTION OF BACKFILL.
- DESIGN**
- THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH CAN/CSA S6.06 UNDER THE FOLLOWING DESIGN PARAMETERS:
    - DESIGN LIVE LOAD = CL-625
    - DESIGN DEAD LOAD = 2H-1V EARTH FILL TOP SLOPE.
    - CONCRETE UNIT WEIGHT = 24.0 kN/m<sup>3</sup>
    - SOIL/BACKFILL UNITWEIGHT = 22.0 kN/m<sup>3</sup>
- REINFORCEMENT**
- ALL REINFORCING STEEL SHALL BE GRADE 400 AND CONFORM TO CAN/CSA G30.18 (LATEST EDITION).
  - ALL WELDED WIRE MESH SHALL HAVE A F<sub>y</sub> = 485 MPA AND CONFORM TO CAN/CSA G30.14 AND G30.15 (LATEST EDITION).
  - ALL REINFORCING SHALL BE DETAILED, FABRICATED, PLACED AND SUPPORTED IN ACCORDANCE WITH CAN/CSA A23.4 (LATEST EDITION).
  - THE CONCRETE COVER OVER PRINCIPAL REINFORCING SHALL BE 50mm ± 10mm AS REQUIRED BY ENVIRONMENTAL EXPOSURE 8.11.2.2 (a) IN CAN/CSA S6.06.
- CONCRETE**
- CONCRETE MIX DESIGNS SHALL CONFORM TO REQUIREMENTS:
    - CONCRETE STRENGTH = 28 MPA AT TIME OF STRIPPING
    - DESIGN CONCRETE STRENGTH OF 45 MPA AT 28 DAYS OR TIME OF SHIPPING
    - 5% TO 7% AIR ENTRAINMENT
    - GLEN HOLME AGGREGATE SHALL BE USED WITH A NOMINAL AGGREGATE SIZE OF 13mm
  - CONCRETE CURING SHALL BE IN CONFORMANCE WITH CAN/CSA A23.1 (LATEST EDITION).
  - SHAW CONCRETE BATCH No. SHALL BE 406.
- ITEMS INCLUDED:**
- HWHAND
  - HWG1050H OR HWG1050V

REV. NO.	REASON	DATE



DRAWING NO.

DRAWING NO.  
STANDARD LAYOUT  
1050 X 1383  
430mmØ - 800mmØ PIPE

DRAWING NO.  
INFLOW & OUTFLOW GRATE  
HEADWALL C/W 430Ø PIPE  
HANDRAIL & SIDE RAIL

CONTRACTOR  
XXXXXXXXXX

DATE  
19 FEBRUARY 2008

SCALE  
N.T.S.

DRAWN  
N. DIMOCK

CHECKED  
R. MacDOW