




NOTES:

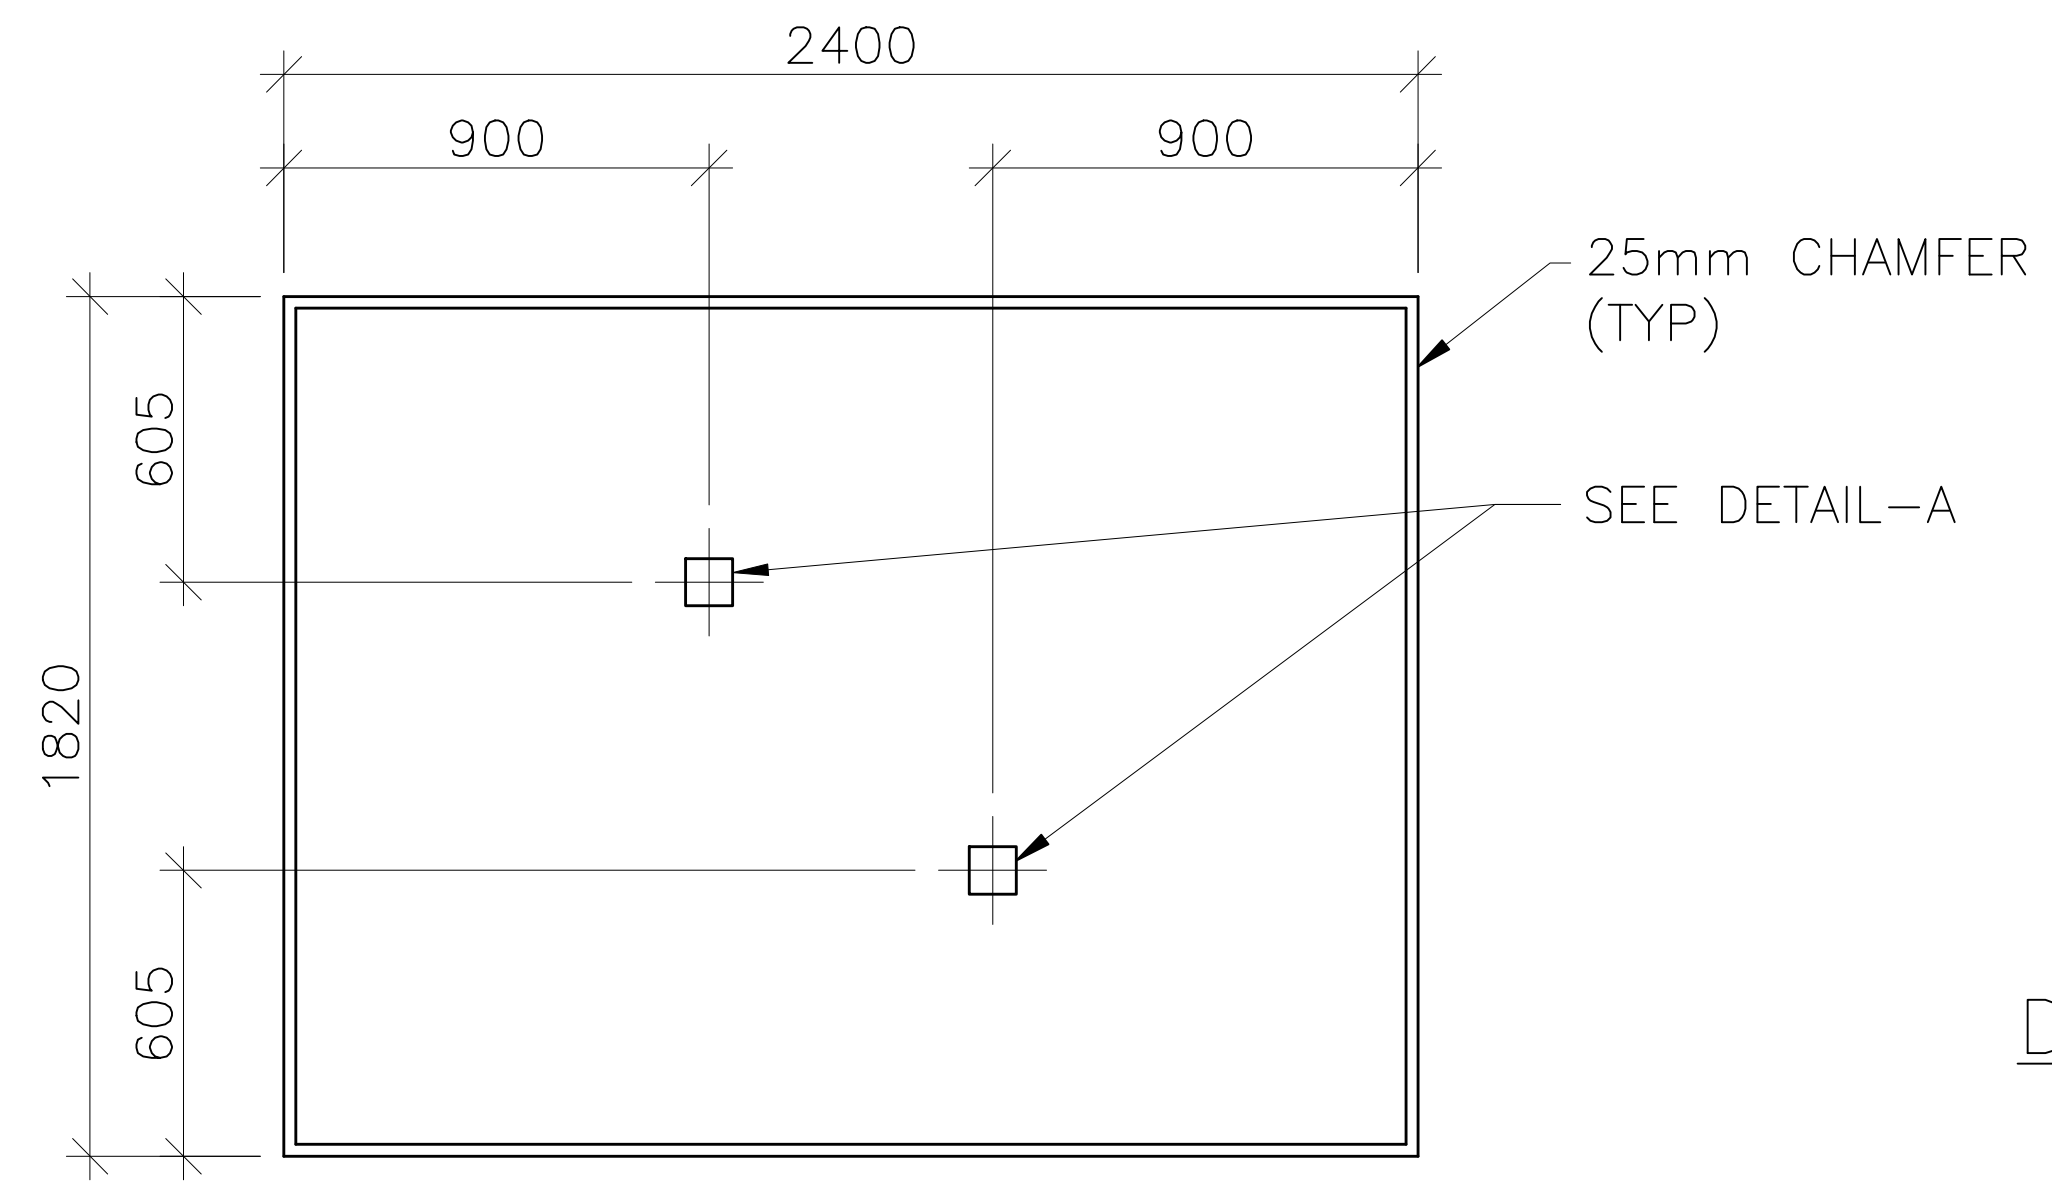

PLAN

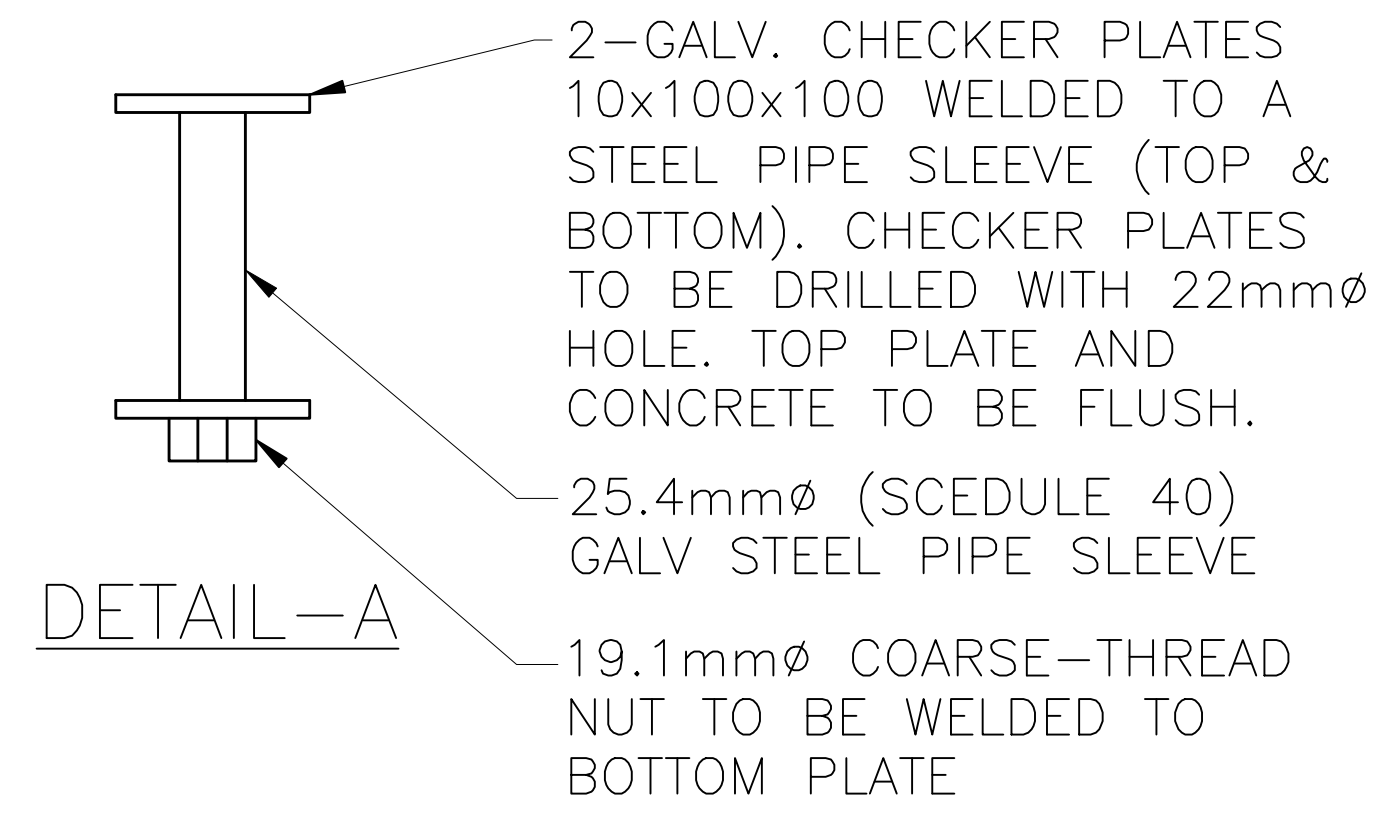


DETAIL-A

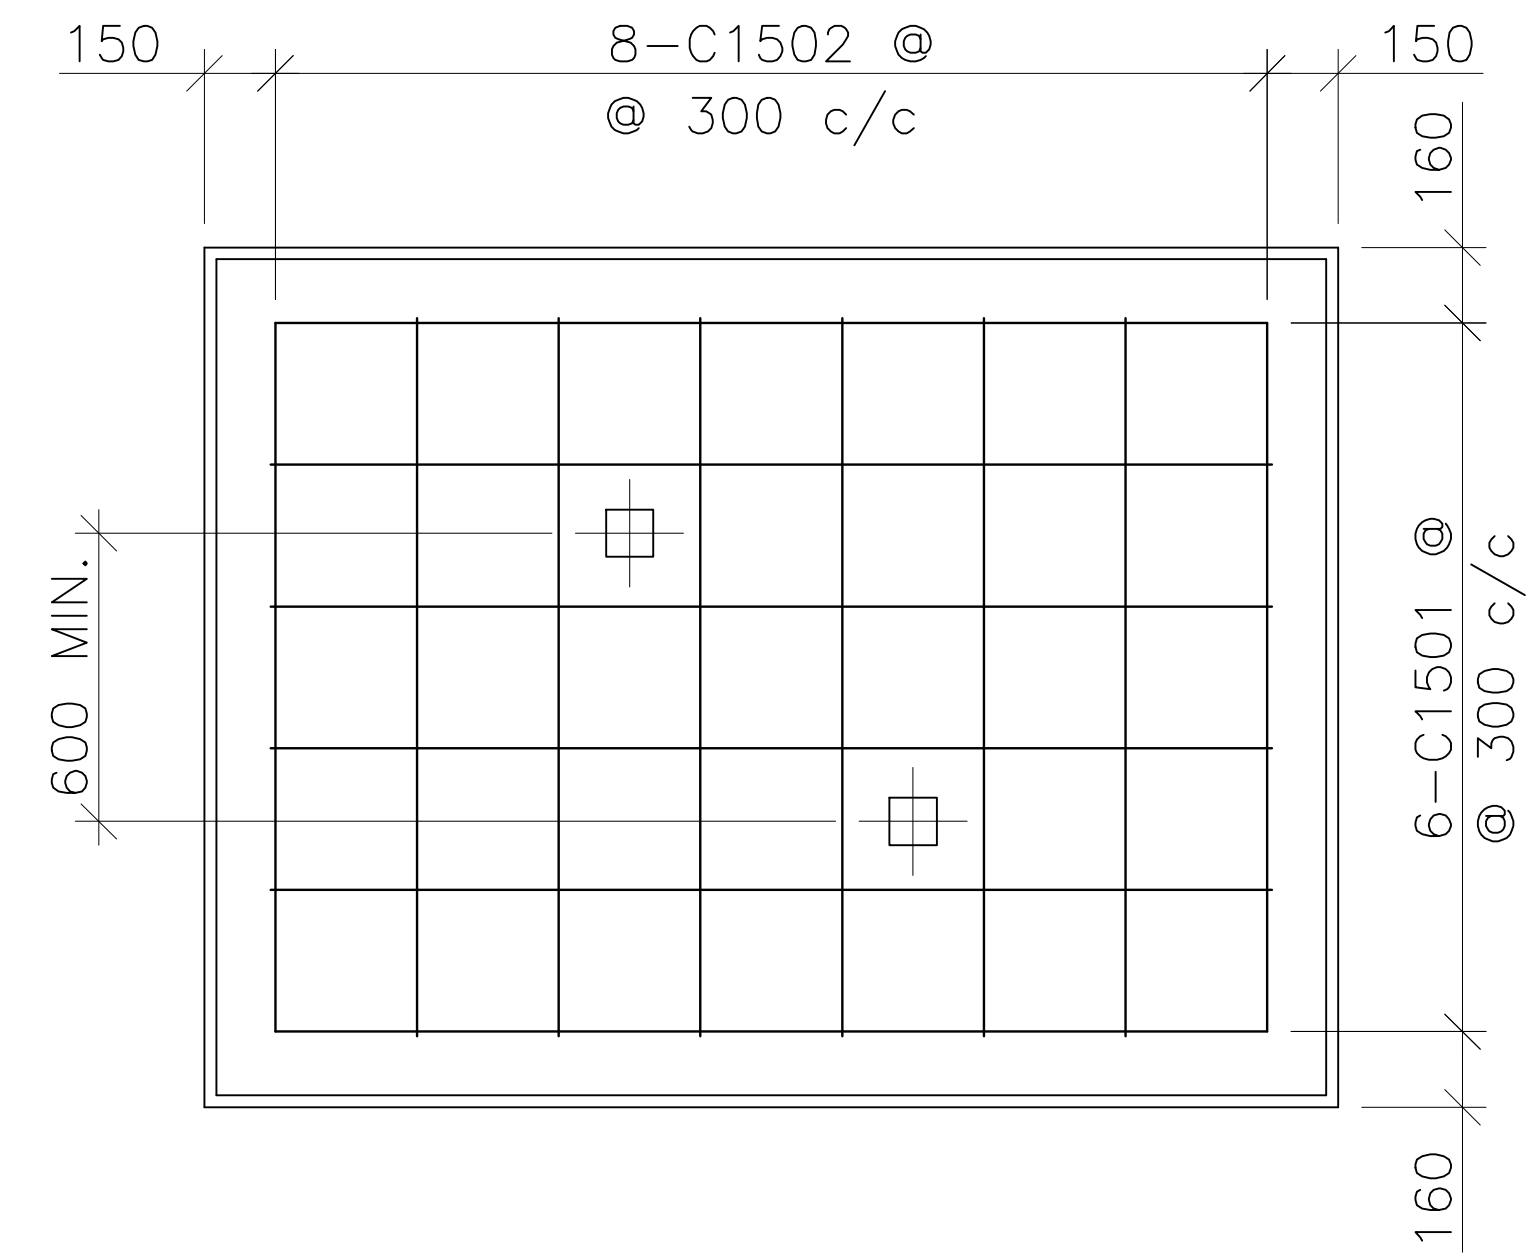


PLAN

REBAR SCHEDULE

C1501-#15M BAR x 2300mm LG - 6 REQUIRED
 C1502-#15M BAR x 1600mm LG - 8 REQUIRED

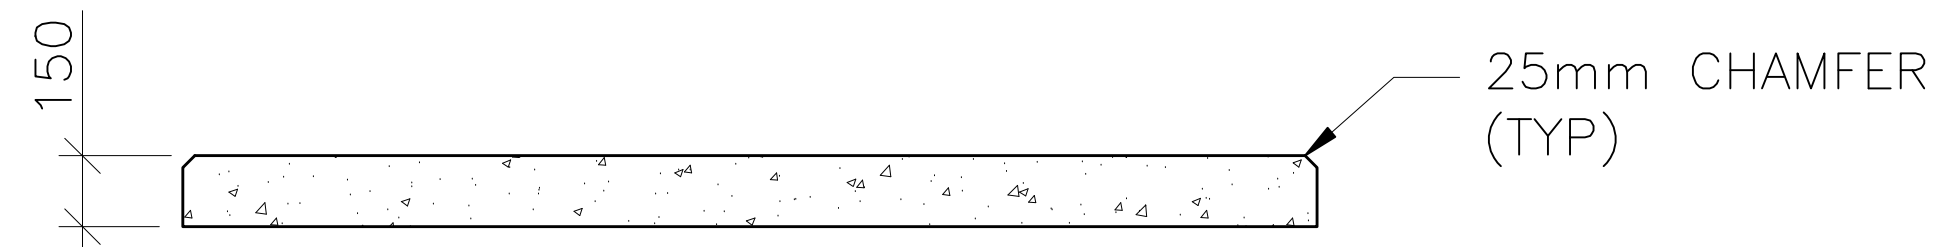


SECTION-A

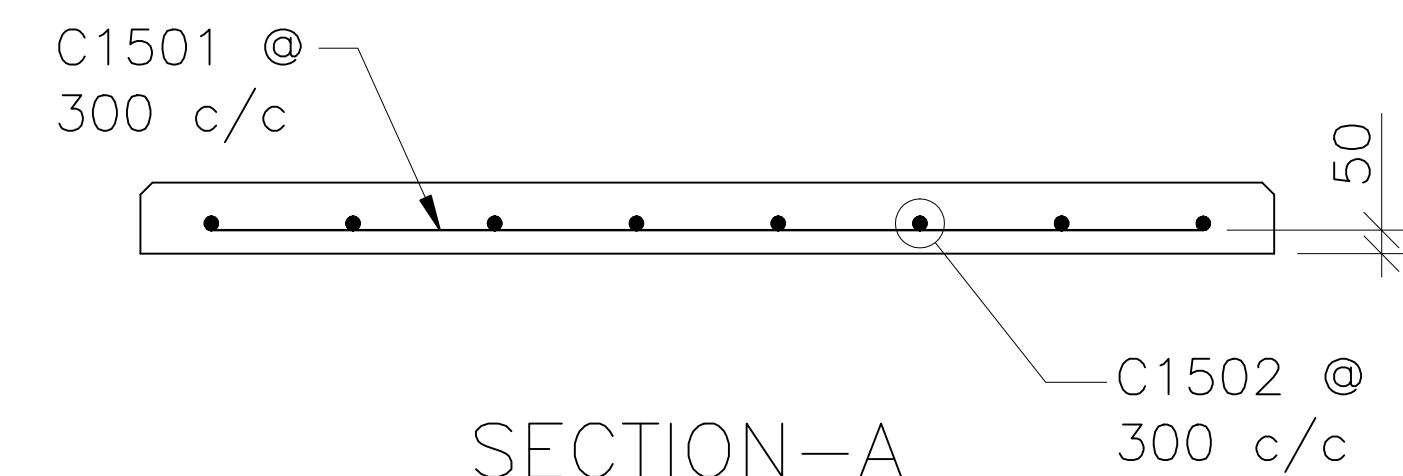

SECTION-A

REV. NO.	REVISION	DATE

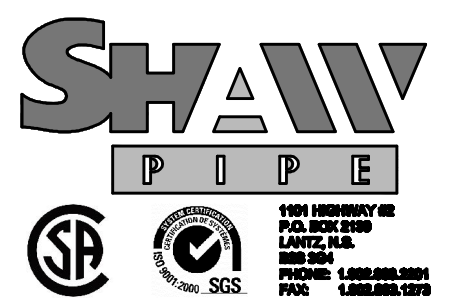

DRAWING NO: 2009NSPI0103

PROJECT TITLE: NS POWER STANDARDS

DRAWING TITLE: 2400x1820 TOP OF FIRE RESISTING BARRIER THREE-PHASE PADMOUNT TRANSFORMER 150KV.A-500KV.A GENERAL ARRANGEMENT

CONTRACTOR:
 DATE: 9 APRIL 2009 SCALE: AS NOTED
 DRAWN: N. DIMOCK CHECKED: R. MACDOW