




NOTES:

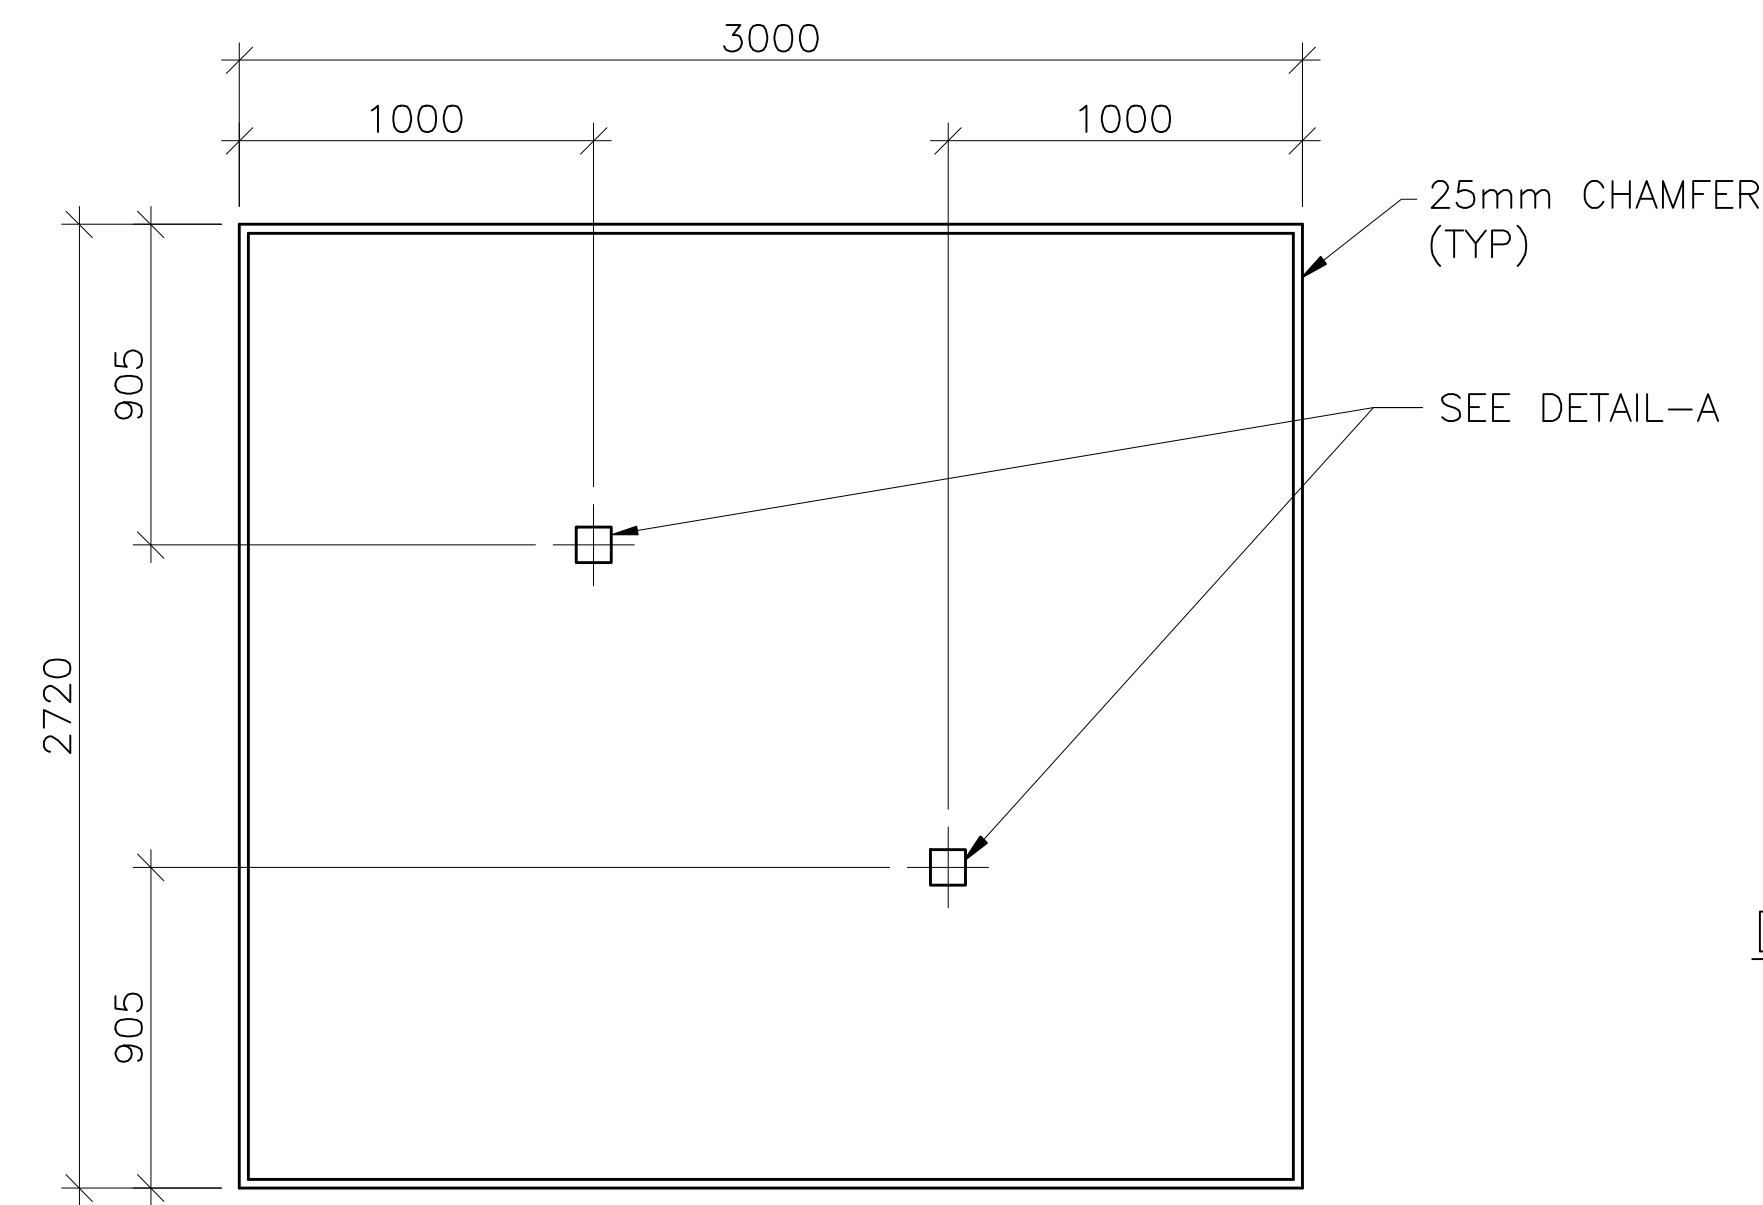

PLAN

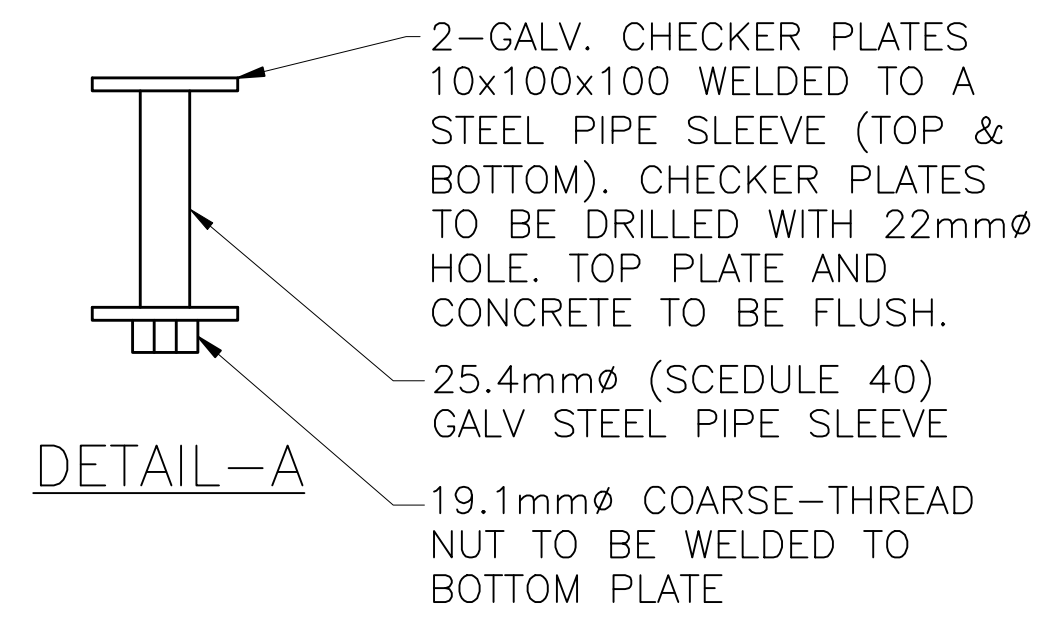


DETAIL-A

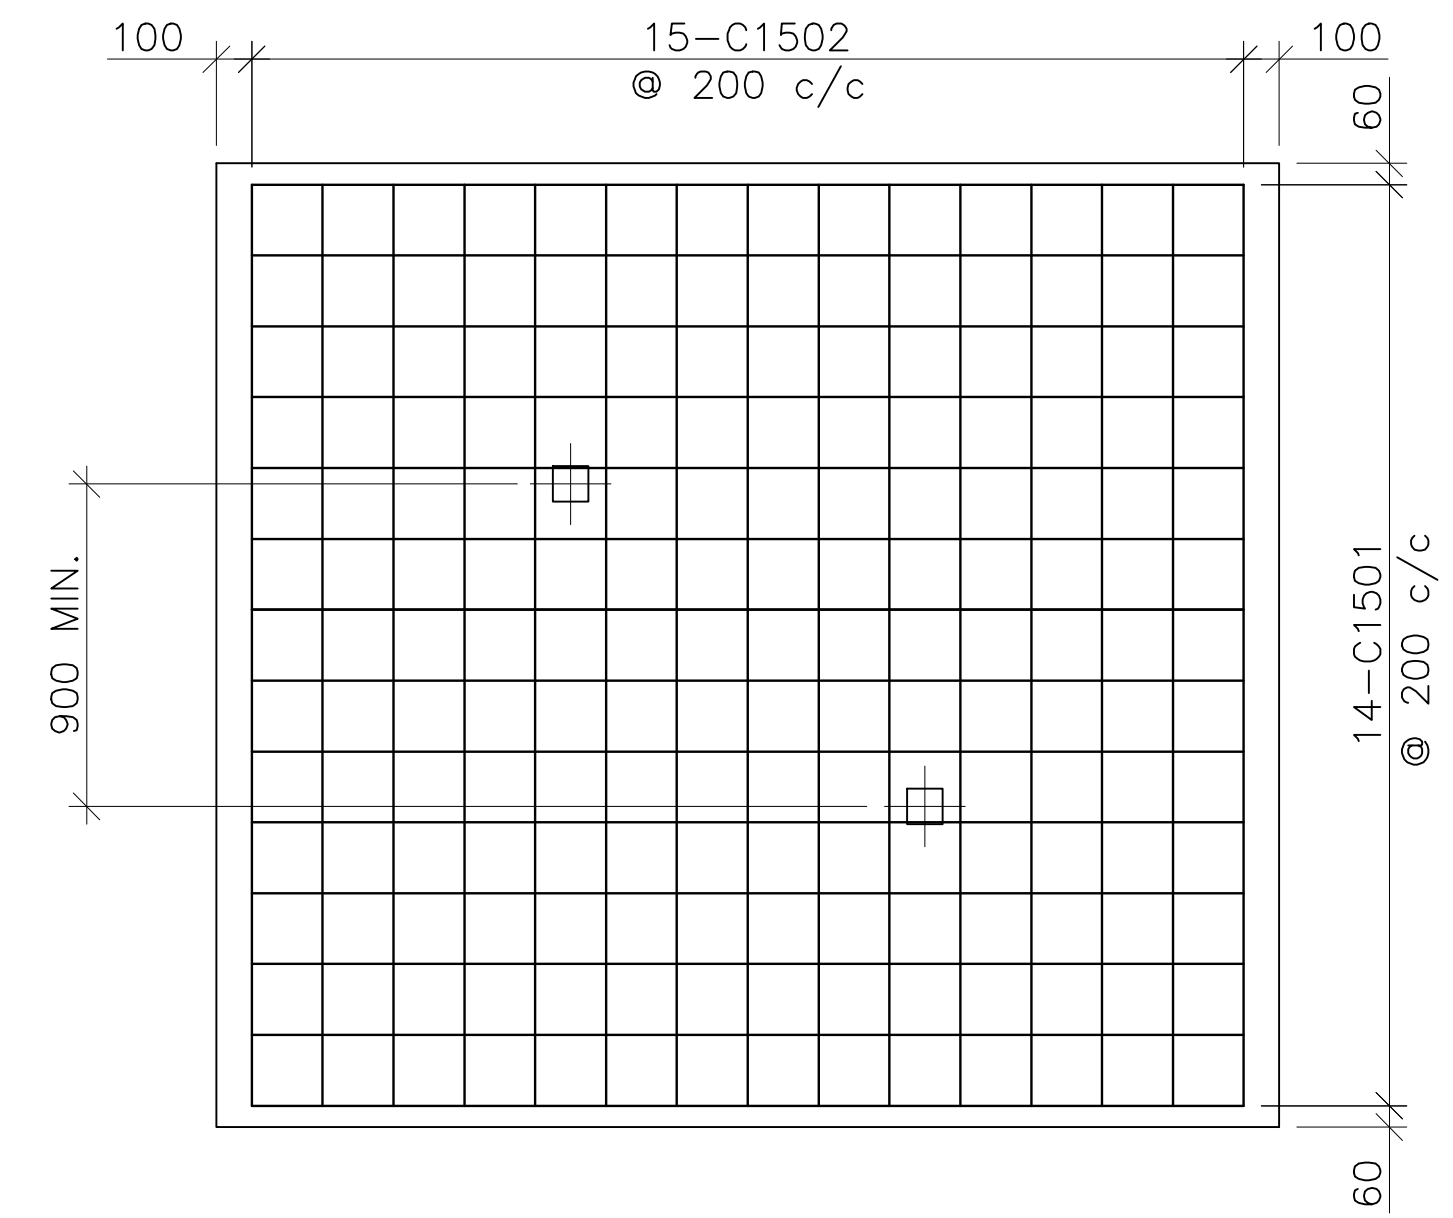


PLAN

REBAR SCHEDULE

C1501-#15M BAR x 2800mm LG - 14 REQUIRED
C1502-#15M BAR x 2500mm LG - 15 REQUIRED

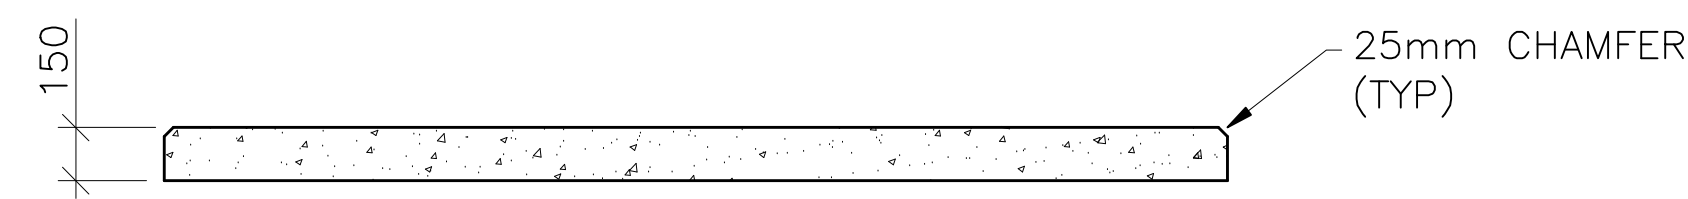

SECTION-A

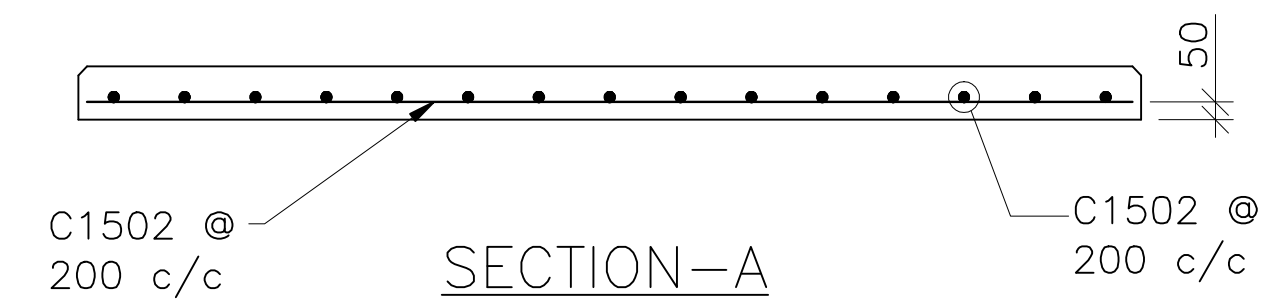

SECTION-A



DRAWING NO: 2009NSPI0105

PROJECT TITLE: NS POWER STANDARDS

DRAWING TITLE: 3000x2720 TOP OF FIRE RESISTING BARRIER THREE-PHASE PADMOUNT TRANSFORMER 750KV.A-2500KV.A GENERAL ARRANGEMENT

CONTRACTOR:

DATE: 9 APRIL 2009 SCALE: AS NOTED

DRAWN: N. DIMOCK CHECKED: R. MACDOW